


# WIRING INSTRUCTIONS

## CRHT102 SERIES CABLE REDUCTION BOX

1. Strip outer jacket of cable back 1¼ in. and remove all of the shielding.
2. Separate the internal wires from the shield and twist the shield.
3. Strip red and black insulation back ¼ in.

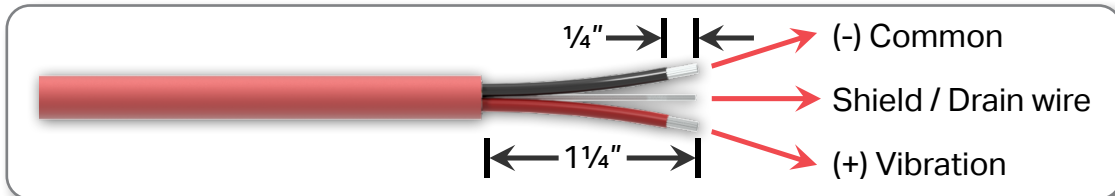

4. While viewing the rear of the panel, locate the appropriate channel. Using a mini flathead screwdriver, loosen the screws for the channel and insert the wires into the termination block.


### Orientation is as follows:

- a. Red insulated conductor wire is connected to (+).
- b. Black insulated conductor wire is connected to (-).
- c. Shield drain wire is connected to ground (GND).
- d. Tighten the screw on each wire to hold it in place.



# WIRING INSTRUCTIONS

## CRHT102 SERIES CABLE REDUCTION BOX

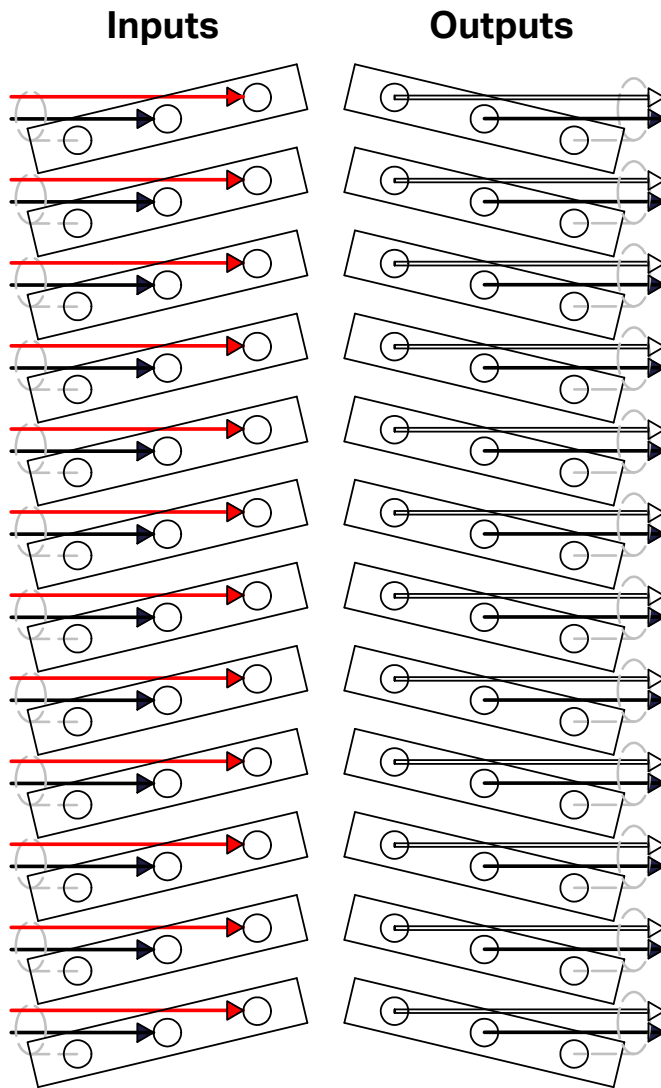

### SENSOR INPUTS

Red = Positive  
Black = Common  
Grey = Ground

### SENSOR OUTPUTS

White = Positive  
Black = Common  
Grey = Ground

